

Zonski korektori sa osjetnicima temperature i vlage zraka prostora



STP CAT5e+  
ili  
LiY-CY 4x0,25+  
za svaki korektor

Zonski korektori sa osjetnicima temperature zraka prostora



STP CAT5e+  
ili  
LiY-CY 4x0,25+  
za svaki korektor

Zonski osjetnici temperature zraka prostora



STP CAT5e+  
ili  
LiY-CY 3x0,25+  
za svaki osjetnik

Elektro-ormar u strojarnici



SA-2-XMS glavni modul upravljanja i TouchScreen upravljački modul



PPY 3x1,5  
(napajanje 230VAC)

2 x STP CAT5e+  
ili  
2 x LiY-CY 4x0,25+

Ventilokonvektori G/H



PPL 5x0,75  
+  
STP CAT5e+ ili LiY-CY 4x0,25+  
za svaki ventilokonvektor



Kupaonski radijatori



**SPECIFIKACIJA INSTALACIJA:**

**ZONSKI OSJETNIK TEMPERATURE**  
**ZONSKI KOREKTOR**  
**VENTILOKONVEKTOR**

STP CAT5e+ ili LiY-CY 3x0,25+  
STP CAT5e+ ili LiY-CY 4x0,25+  
PPL 5x0,75 + STP CAT5e+ ili  
LiY-CY 4x0,25+

**KOMUNIKACIJA**





PPL 5x0,75 + 2xSTP CAT5e+  
ili 2xLiY-CY 4x0,25+

**NAPAJANJE**

PPY 3x1,5 ili sl.

**NAZIVNI NAPONI:**

- osjetnici temperature, korektori: **5VDC / 12VDC**  
- ventilokonvektori, termo-motorni pogoni: **230VAC / 50Hz**

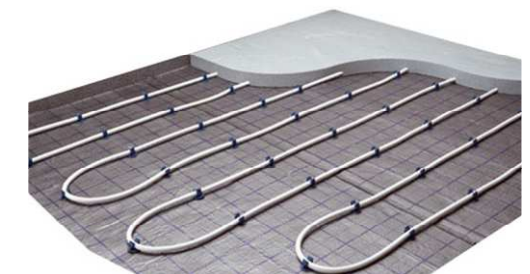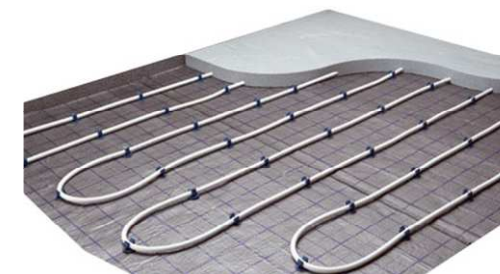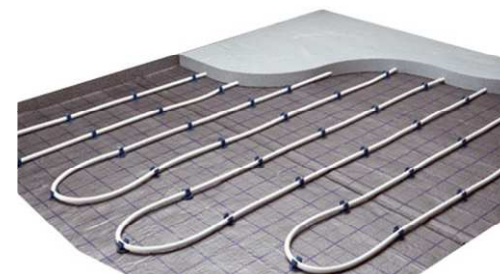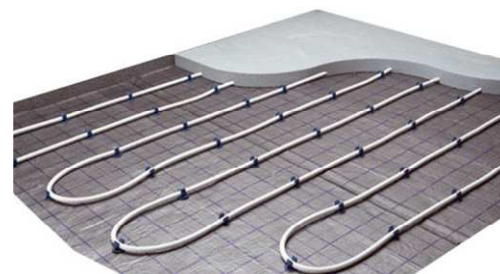

Podno grijanje i/ili plošno (zidno/stropno) G/H

**EKO PLAM d.o.o.**

Novo Selo Lasinjsko 55a, 46206 Lasinja www.ekoplam.hr info@ekoplam.hr

Blok-shema 2016-1 V#2 rev#1

Izradio: Goran Sokolovski